



## Gasmaster

# Gas Detection Control Panels

Large display

User friendly

Versatile input and output functions


Modular design

Up to four detectors



### Gasmaster

# 1-4 Channel Gas Detection Control Panel

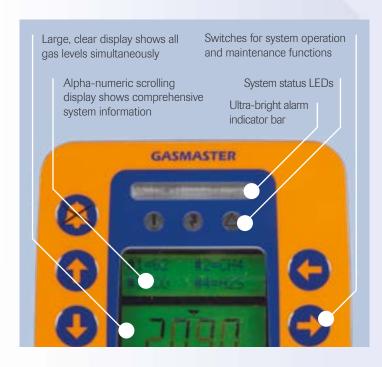



#### Large display

All gas levels are displayed simultaneously	Enables full systems status check at a glance
Alarm messages can be customised to indicate the name or location of any detector in alarm	
The LCD can be set to display in many languages	

#### User friendly

Menu system is intuitive and easy to use	Enables configuration changes to be made easily
All functions, from day-to-day operation to re-calibration, can be carried out from the front panel	Routine testing can be performed rapidly
Event log feature	Enables system fault and alarm history to be viewed

#### **Product description**

Crowcon Gasmaster provides all the information you need about your gas and fire detectors at a glance. The large multi-lingual display shows gas levels from all detectors simultaneously, and enables system adjustment and testing using buttons on the front panel. Crowcon Gasmaster can operate 'stand-alone' or interface with any alarm devices and control systems using a selection of outputs.



#### Versatile input and output features


Provides analogue, relay and Modbus outputs	Facilitating communication around the site	
Flexibility	Gasmaster can monitor up to four detectors in virtually any combination of gas detectors, fire zones or Environmental Sampling Unit*	
	Software enables re-configuration and event log upload in an instant**	
Two levels of independent alarm per channel	Can be configured to suit site requirements	
Remote inhibit and reset facilities	Enables control from any point on your site	
Compatible with 4-20mA or mV pellistor type gas detectors	mV pellistor detectors reduce system purchase and maintenance costs	

#### Modular design

You only need to purchase the required number of input modules

1, 2 and 3 channel systems can be extended later by adding additional modules  $^{***}$ 

\*\*\* Gasmaster 4 only

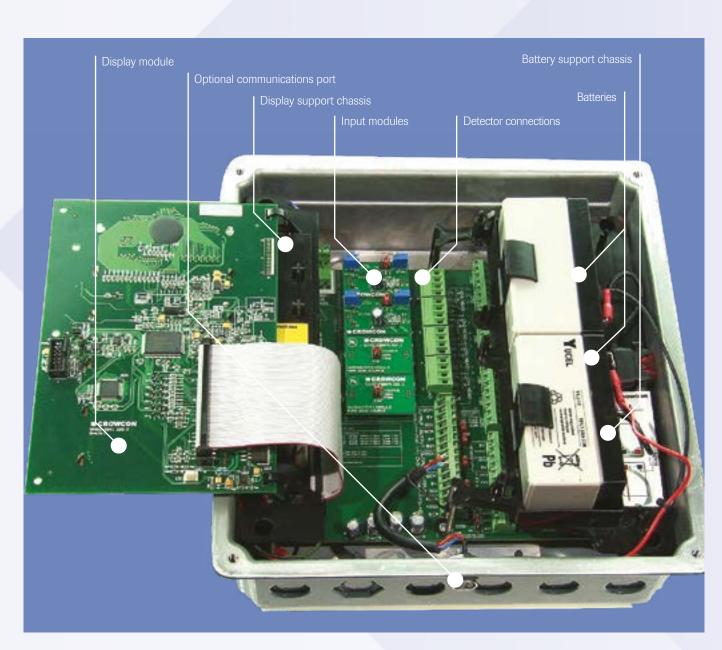

<sup>\*</sup> Contact Crowcon for details

<sup>\*\*</sup> Event Log access requires optional PC communications kit

Specifi	cation	Gasmaster 1	Gasmaster 4	
Size		288 x 278 x 110mm (11.3 x 10.9 x 4.3 ins)		
Weight		4.5kg (10lbs)		
Enclosure n	naterial	Back-box: cast aluminium		
		Front cover: ABS (flame retardant)		
Ingress prot	tection	IP65		
Power		100-240Vac 50-60Hz or		
		20-30Vdc, 60W max		
Battery bac	k-up	1.2Ah batteries fitted internally		
Operating to	emperature	-10°C to +50°C (14°F to 122°F)		
Humidity		0 to 95% RH non-condensing		
Inputs Gas Fire	Gas	One 2 or 3 wire 4-20mA gas detector (sink or source) or mV pellistor flammable gas detector	One to four 2 or 3 wire 4-20mA gas detectors (sink or source) or mV pellistor flammable gas detectors	
	Fire	One loop of up to 20 conventional smoke/heat detectors or manual call points, or one flame detector (4-20mA or digital contact signal)	One to four loops of up to 20 conventional smoke/heat detectors or manual call points, or one to four flame detectors	
	Environmental Sampling Unit	For use with one Crowcon ESU fan	For use with one to four Crowcon ESU fans	
	Remote inhibit	Via normally open contact		
	Remote reset	Via normally open contact	normally open contact	
Outputs	Relays DPCO contacts rated 250Vac 8A. Relays can be set as energised or de-energised, latching or non-latching, latching acceptable	Low alarm. High alarm. Fault. Alarm relays can be set for rising or falling alarms. Hysteresis can be adjusted on low alarms	Low alarm and high alarm per channel plus common low, high and fault. Alarm relays can be set for rising or falling alarms. Hysteresis can be adjusted on low alarms	
	A/V alarm drive	12Vdc or 24Vdc 650mA max. drive. Suitable for +ve or -ve switched alarms		
	Analogue	4-20mA (current source, max. loop resistance 700 $\Omega$ ) or 1-5Vdc (min. load 50k $\Omega$ )	4-20mA for each channel (current source, max. loop resistance 700 $\Omega$ or 1-5Vdc (min. load 50k $\Omega$ )	
	Serial link	RS-485 Modbus RTU for monitoring and control via DCS/SCADA/PLC systems		
Communica	ations port	Optional port for PC configuration and event log upload		
Event loggir	ng*	Time-stamped log of up to 300 alarms, fault or system intervention activities		
Panel indica	ation	LCD back-lit display shows gas level (in ppb, ppm, % volume or % LEL units), and scrolling alpha-numeric status indication. LED's for Alarm, Fault, Power and Warning. Integral 85dB sounder (at 10cm)		
Approvals		EMC: EN50270, EN60945, FCC: CFR 47 Part 15; ICES-003 ATEX: May be used in a non-hazardous area as part of Intrinsically Safe System conforming to EN60079-25 Baseefa 05Y0090/1		
Functional s	safety	Validated to IEC61508 SIL2		

Tel.: 03303 / 50 40 66

Fax.: 03303 / 50 40 68

#### Disclaimer

Every effort has been made to ensure the accuracy of this document at the time of printing. In accordance with the company's policy of continued product improvement Crowcon Detection Instruments Limited reserves the right to make product changes without notice. The products are routinely subject to a programme of testing which may result in some changes in the characteristics quoted. Technical information contained in this document or otherwise provided by Crowcon are based upon records, tests, or experience that the company believes to be reliable, but the accuracy, completeness, and representative nature of such information is not guaranteed.

Many factors beyond Crowcon Detection Instruments' control and uniquely within user's knowledge and control can affect the use and performance of a Crowcon product in a particular application. As the products may be used by the client in circumstances beyond the knowledge and control of Crowcon Detection Instruments Limited, we cannot determine the relevance of these to an individual oustomer's application. It is the clients' sole responsibility to carry out the necessary tests to evaluate the usefulness of the products and review all applicable regulations and standards to ensure their safety of operation in a particular application.

<sup>\*</sup>Event log access requires a Gasmaster PC communications kit and communications port.